



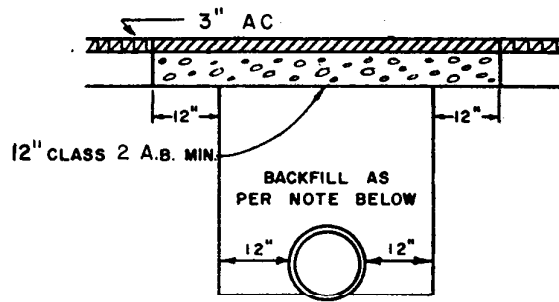

TYPE A


**ASPHALTIC CONCRETE OR
SEALCOAT STREETS**

NOTE: Trench must be vertically cut with smooth edges and neat lines.

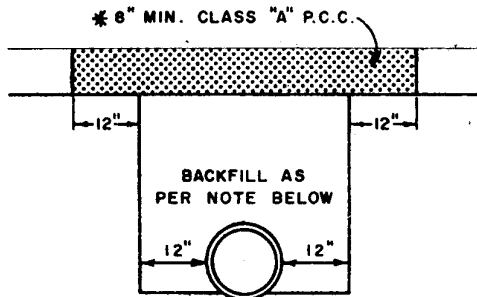

TYPE B

**PORTLAND CEMENT CONCRETE
STREETS**

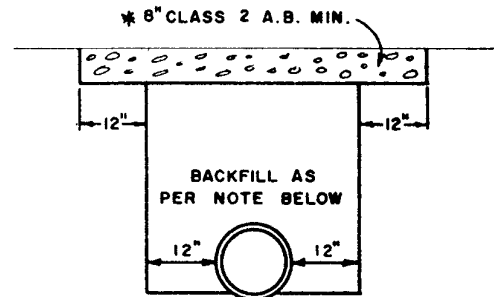

TYPE C

**UNIMPROVED STREETS, ALLEYS
OR EASEMENTS**

NOTES:

All work shown above shall conform to the applicable sections of the standard specifications.

All excavation within public right of way shall be backfilled in accordance with section 19-3 of the standard specifications.

Area adjacent to the trench shall be left in a condition equal to or better than that existing prior to construction.

Seal Coat - Bituminous binder shall be covered with either sand or screenings to match existing surface.

* Structural Section elements may be increased where required by the Department of Public Works due to soil conditions and traffic considerations. The replacement structural section shall equal the existing structural section as a minimum requirement, except that the section shown above is an Absolute Minimum.

COUNTY OF COLUSA		DEPARTMENT OF PUBLIC WORKS	
TITLE	TYPICAL DETAILS OF PAVEMENT REPLACEMENT AND BACKFILL REQUIREMENTS	STANDARD NO.	S-17
		SCALE:	$\frac{3}{8}'' = 1' - 0''$