



GREENBERG TYPE 53 GR,
OR 54 GR OR EQUAL.

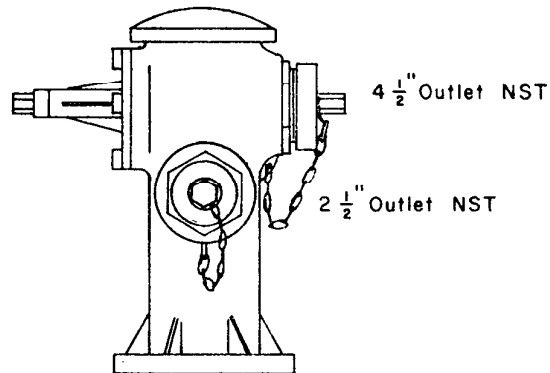

**IMPROVED LOS ANGELES
TYPE HYDRANT**

GREENBERG TYPE
NO. 123 OR EQUAL.

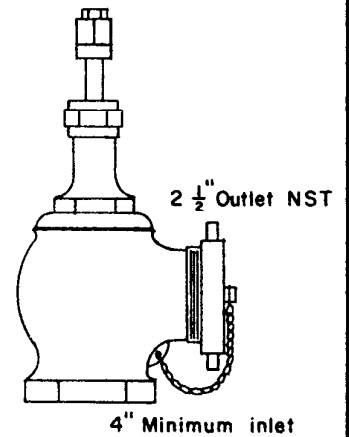

WHARF HYDRANT

NOTE :

- (1) Each hydrant must be gated between hydrant and street main.
- (2) Each hydrant shall be placed in such a manner that the 4--" outlet or wharf hydrant outlet faces the street.
- (3) For easy access to fire engines, hydrant shall be placed within 36" maximum from curb or shoulder of roadway.
- (4) In area of prolonged freezing temperatures, barrel must be of dry type or protected from freezing.
- (5) Hose threads on outlets to be National Standard dimensions.
- (6) Hydrants outlet shall not be less than 18" or more than 25" above roadway level.

COUNTY OF COLUSA		DEPARTMENT OF PUBLIC WORKS	
TITLE	STANDARD FIRE HYDRANTS	STANDARD NO.	S - 28
		SCALE :	NONE